

## Technical Information

## STG700 SmartLine Gauge Pressure Specification 34-ST-03-102



### Introduction

Part of the SmartLine® family of products, the STG700 and STG70L are suitable for monitoring, control and data acquisition. STG70X products feature piezoresistive sensor technology combining pressure sensing with on chip temperature compensation capabilities providing high accuracy, stability and performance over a wide range of application pressures and temperatures. The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications.

### Best in Class Features:

- Accuracy up to 0.065 % of calibrated span
- Stability up to 0.02% of URL per year for five years
- Automatic temperature compensation
- Rangeability up to 100:1
- Response times as fast as 100ms
- Alphanumeric display capabilities
- External zero, span, & configuration capability
- Polarity insensitive electrical connections
- On-board diagnostic capabilities
- Integral Dual Seal design for safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0
- Full compliance to SIL 2/3 requirements as a standard.
- Modular design characteristics

### Span & Range Limits:

Model	URL/Ma x Span psi (bar)	LRL psi (bar)	Min Span	Turn down
STG730/STG73L	50 (3.5)	-14.7 (-1.0)	0.5 (0.035)	100:1
STG740/STG74L	500 (35)	-14.7 (-1.0)	5 (.35)	100:1
STG770/STG77L	3000 (210)	-14.7 (-1.0)	30 (2.1)	100:1
STG78L	6000 (420)	-14.7 (-1.0)	60 (4.2)	100:1
STG79L	10000	-14.7 (-1.0)	100 (6.9)	100:1



Figure 1 – STG700 Gauge Pressure Transmitters feature field-proven piezoresistive sensor technology

### Communications/Output Options:

- Honeywell Digitally Enhanced (DE)
- HART® (version 7.0)
- FOUNDATION™ Fieldbus

All transmitters are available with the above listed communications protocols.

## Description

The SmartLine family pressure transmitters are designed around a high performance piezo-resistive sensor. This one sensor actually integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements. This level of performance allows the ST 700 to replace most competitive transmitters available today.

## Indication/Display Option

The ST 700 modular design accommodates a basic alphanumeric LCD display.

### Basic Alphanumeric LCD Display Features

- Modular (may be added or removed in the field)
- 0, 90, 180, & 270 degree position adjustments
- Configurable (HART only) and standard (Pa, KPa, MPa, KGcm<sup>2</sup>, Torr, ATM, inH<sub>2</sub>O, mH<sub>2</sub>O, bar, mbar, inH<sub>2</sub>O, inHG, FTH<sub>2</sub>O, mmH<sub>2</sub>O, mm HG, & psi) measurement units
- 2 Lines 16 Characters (4.13H x 1.83W mm)
- Square root output indication (✓)

## Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing **lower overall operational costs**

## Configuration Tools

### Integral Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offers the ability to configure the transmitter and display via three externally accessible buttons when a display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of the display option.

### Hand Held Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. This is accomplished via Honeywell's field-rated Multiple Communication Configurator (MCT202).

The MCT202 is capable of field configuring DE and HART Devices and can also be ordered for use in intrinsically safe environments. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any properly validated hand held configuration device.

### Personal Computer Configuration

Honeywell's SCT 3000 Configuration Toolkit provides an easy way to configure Digitally Enhanced (DE) instruments using a personal computer as the configuration interface. Field Device Manager (FDM) Software and FDM Express are also available for managing HART & Fieldbus device configurations.

## System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE/Fieldbus.
- Integration with Honeywell's Experion PKS offers the following unique advantages.
- Tamper reporting
- FDM Plant Area Views with Health summaries
- All ST 700 units are Experion tested to provide the highest level of compatibility assurance

## Modular Design

To help contain maintenance & inventory costs, all ST 700 transmitters are modular in design supporting the user's ability to replace meter bodies, add indicators or change electronic modules without affecting overall performance or approval body certifications. Each meter body is uniquely characterized to provide in-tolerance performance over a wide range of application variations in temperature and pressure and due to the Honeywell advanced interface, electronic modules may be swapped with any electronics module without losing in-tolerance performance characteristics.

### Modular Features

- Meter body replacement
- Exchange/replace electronics/comms modules\*
- Add or remove integral indicator\*
- Add or remove lightning protection (terminal connection)\*

\* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell's unique modularity results in **lower inventory needs and lower overall operating costs**.

## Performance Specifications

**Reference Accuracy:** (conformance to +/-3 Sigma)

Table 1

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Stability (% URL/Year for five years)	Reference Accuracy <sup>1,2</sup> (% Span)
Standard Accuracy	STG730	50 psi (3.5 bar)	-14.7 psi (-1.0 bar)	0.5 psi (.035 bar)	100:1	0.0650%
	STG73L	50 psi (3.5 bar)	-14.7 psi (-1.0 bar)	0.5 psi (.035 bar)		
	STG740	500 psi (35 bar)	-14.7 psi (-1.0 bar)	5 psi (.35 bar)		
	STG74L	500 psi (35 bar)	-14.7 psi (-1.0 bar)	5 psi (.35 bar)		
	STG770	3000 psi (210 bar)	-14.7 psi (-1.0 bar)	30 psi (2.1 bar)		
	STG77L	3000 psi (210 bar)	-14.7 psi (-1.0 bar)	30 psi (2.1 bar)		
	STG78L	6000 psi (420 bar)	-14.7 psi (-1.0 bar)	60 psi (4.2 bar)		
	STG79L	10000 psi (690 bar)	-14.7 psi (-1.0 bar)	100 (6.9 bar)		

Zero and span may be set anywhere within the listed (URL/LRL) range limits

**Accuracy, Span and Temperature Effect:** (Conformance to +/-3 Sigma)

Table 2

		Accuracy <sup>1,2</sup> (% of Span)			Temperature Effect (% Span/50°F)		
		For Turndowns Greater Then	A	B	C psi (bar)	D	E
Model	URL						
Standard Accuracy	STG730	50 psi (3.5 bar)	25:1	0.025	2 (0.14)	0.060	0.005
	STG73L	50 psi (3.5 bar)	12.5:1		4 (0.28)		0.010
	STG740	500 psi (35 bar)	25:1		20 (1.4)		0.007
	STG74L	500 psi (35 bar)	25:1		30 (2.1)		0.010
	STG770	3000 psi (210 bar)	10:1		300 (21.0)	0.050	0.010
	STG77L	3000 psi (210 bar)	10:1		350 (24.2)		0.015
	STG78L	6000 psi (420 bar)	12:1		500 (34.4)		0.050
	STG79L	10000 psi (690 bar)	10:1		1000 (69.0)		0.100
		Turn Down Effect $\pm \left[ A + B \left( \frac{C}{Span} \right) \right] % Span$			Temp Effect $\pm \left[ D + E \left( \frac{URL}{Span} \right) \right] % Span per 28°C (50°F)$		

### Total Performance (% of Span):

$$\text{Total Performance Calculation: } = \pm \sqrt{(\text{Accuracy})^2 + (\text{Temperature Effect})^2}$$

**Total Performance Examples (for comparison):** @ 5:1 Turndown, +/-50 °F (28°C) shift

**STG730 @ 100 psi:** 0.107% of span

**STG740 @ 100 psi:** 0.107% of span

**STG770 @ 600 psi:** 0.119 % of span

**STG78L @ 1200 psi:** 0.307% of span

**STG73L @ 100 psi:** 0.119% of span

**STG74L @ 100 psi:** 0.119% of span

**STG77L @ 600 psi:** 0.141% of span

**STG79L @ 2000 psi:** 0.653% of span

### Typical Calibration Frequency:

Calibration verification is recommended every two (2) years

#### Notes:

1. Terminal Based Accuracy - Includes combined effects of linearity, hysteresis, and repeatability. Analog output adds 0.005% of span.

2. For zero based spans and reference conditions of: 25 °C (77°F) for LRV >= 0 psia, 10 to 55% RH, and 316 Stainless Steel barrier diaphragm.

### Operating Conditions – All Models

Parameter	Reference Condition		Rated Condition		Operative Limits		Transportation and Storage	
	°C	°F	°C	°F	°C	°F	°C	°F
Ambient Temperature <sup>1</sup>	25±1	77±2	-40 to 85	-40 to 185	-40 to 85	-40 to 185	-55 to 120	-67 to 248
Meter Body Temperature <sup>2</sup>	25±1	77±2	-40 to 110	-40 to 230	-40 to 125	-40 to 257	-55 to 120	-67 to 248
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100	
Vac. Region – Min. Pressure mmHg absolute inH <sub>2</sub> O absolute	Atmospheric		25		2 (short term) <sup>3</sup>	<sup>3</sup>		
Atmospheric			13		1 (short term) <sup>3</sup>			
Supply Voltage	10.8 to 42.4 Vdc at terminals							
Load Resistance	0 to 1,440 ohms (as shown in Figure 2)							
Maximum Allowable Working Pressure (MAWP) <sup>4, 5</sup>  (ST700 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	STG730: 50 psi (3.5 bar) STG740: 500 psi (35 bar) STG770: 3000 psi (210 bar )		STG73L: 50 psi (3.5 bar) STG74L: 500 psi (35 bar ) STG77L: 3000 psi (210 bar ) STG78L: 6000 psi (420 bar ) STG79L: 10000 psi (690 bar )					

<sup>1</sup> LCD Display operating temperature -20°C to +70°C Storage temperature -30°C to 80°C.

<sup>2</sup> Silicone 704 minimum temperature rating is 0°C (32°F). NEOBEE® M-20 minimum temperature rating is -15°C (5°F)

NEOBEE® is a registered trademark of Stepan Company

<sup>3</sup> Short term equals 2 hours at 70°C (158°F)

<sup>4</sup> Units can withstand overpressure of 1.5 x MAWP without damage

<sup>5</sup> Consult the factory for MAWP of ST 700 transmitters with CRN approval

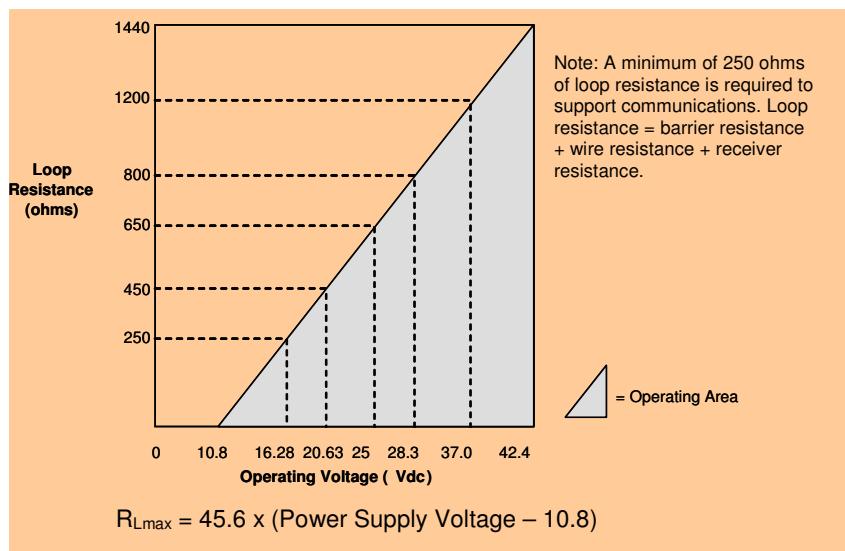


Figure 2 - Supply voltage and loop resistance chart & calculations

### Performance Under Rated Conditions – All Models

Parameter	Description	
<b>Analog Output</b> <b>Digital Communications:</b>	Two-wire, 4 to 20 mA (HART & DE Transmitters only) Honeywell DE, HART 7 protocol or FOUNDATION Fieldbus ITK 6.0.1 compliant All transmitters, irrespective of protocol have polarity insensitive connection.	
<b>HART &amp; DE Output Failure Modes</b> (NAMUR for DE Units requires selecting display and configuration buttons or factory configuration)	<b>Honeywell Standard:</b> <b>Normal Limits:</b> 3.8 – 20.8 mA <b>Failure Mode:</b> ≤ 3.6 mA and ≥ 21.0 mA	<b>NAMUR NE 43 Compliance:</b> 3.8 – 20.5 mA ≤ 3.6 mA and ≥ 21.0 mA
<b>Supply Voltage Effect</b>	0.005% span per volt.	
<b>Transmitter Turn on Time</b> (includes power up & test algorithms)	HART or DE: 2.5 sec Foundation Fieldbus: Host dependant	
<b>Response Time</b> (delay + time constant)	<b>DE/HART Protocol</b> 100ms	<b>FOUNDATION Fieldbus</b> 150ms (Host Dependant)
<b>Damping Time Constant</b>	<b>HART:</b> Adjustable from 0 to 32 seconds in 0.1 increments. <b>Default Value:</b> 0.5 seconds <b>DE:</b> Discrete values 0, 0.16, 0.32, 0.48, 1, 2, 4, 8, 16, 32 seconds. <b>Default Value:</b> 0.48 seconds	
<b>Vibration Effect:</b>	Less than +/- 0.1% of URL w/o damping Per IEC60770-1 field or pipeline, high vibration level (10-2000Hz: 0.21 displacement/3g max acceleration)	
<b>Electromagnetic Compatibility</b>	IEC 61326-3-1	
<b>Lightning Protection Option</b>	<b>Leakage Current:</b> 10uA max @ 42.4VDC 93C <b>Impulse rating:</b> 8/20uS 5000A (>10 strikes) 10000A (1 strike min.) 10/1000uS 200A (> 300 strikes)	

### Materials Specifications (see model selection guide for availability/restrictions with various models)

Parameter	Description
<b>Barrier Diaphragms Material</b>	<b>STG700:</b> 316L SS, Hastelloy® C-276 <sup>2</sup> , Monel® 400 <sup>3</sup> , Tantalum <b>STG70L:</b> 316L SS, Hastelloy C-276
<b>Process Head Material</b>	<b>STG700:</b> Carbon Steel (Zinc Plated) <sup>5</sup> , 316 SS <sup>4</sup> , Hastelloy® C-276 <sup>6</sup> , Monel® 400 <sup>7</sup> <b>STG70L:</b> 316 SS <sup>4</sup>
<b>Vent/Drain Valves &amp; Plugs</b> <sup>1</sup>	<b>STG700:</b> 316 SS <sup>4</sup> , Hastelloy C-276 <sup>2</sup> , Monel 400 <sup>7</sup> <b>STG70L:</b> N/A
<b>Head Gaskets</b>	<b>STG700:</b> Glass-filled PTFE standard. Viton® and graphite are optional. <b>STG70L:</b> N/A
<b>Meter Body Bolting</b>	<b>STG700:</b> Carbon Steel (Zinc plated) standard. Options include 316 SS, NACE A286 SS bolts and nuts or NACE A286 SS bolts and 304 SS nuts <b>STG70L:</b> N/A
<b>Mounting Bracket</b>	Carbon Steel (Zinc-plated) or 304 Stainless Steel or 316 Stainless Steel. See Figures 4 & 5
<b>Fill Fluid</b>	Silicone, CTFE, NEOBEE M-20, Silicone 704.
<b>Electronic Housing</b>	Pure Polyester Powder Coated Low Copper (<0.4%)-Aluminum. Meets NEMA 4X, IP66, IP67 and NEMA 7 (explosion proof). All stainless steel housing is optional.
<b>Process Connections</b>	<b>STG700:</b> ½ -inch NPT(female), DIN 19213 (standard) <b>STG70L:</b> ½ -inch NPT(female), ½ -inch NPT male, 9/16 Aminco, DIN19213 (except STG79L), G1½ -B Male Thread
<b>Wiring</b>	Accepts up to 16 AWG (1.5 mm diameter).
<b>Dimensions</b>	See Figures 4 & 5
<b>Net Weight</b>	<b>STG700:</b> 8.3 pounds (3.8 Kg). <b>STG70L:</b> 3.6 pounds (1.6 Kg) with Aluminum Housing

<sup>1</sup> Vent/Drains are sealed with Teflon®

<sup>2</sup> Hastelloy® C-276 or UNS N10276

<sup>3</sup> Monel® 400 or UNS N04400

<sup>4</sup> Supplied as 316 SS or as Grade CF8M, the casting equivalent of 316 SS.

<sup>5</sup> Carbon Steel heads are zinc-plated and not recommended for water service due to hydrogen migration. For that service, use 316 stainless steel wetted Process Heads.

<sup>6</sup> Hastelloy® C-276 or UNS N10276. Supplied as indicated or as Grade CW12MW, the casting equivalent of Hastelloy® C-276

<sup>7</sup> Monel® 400 or UNS N04400. Supplied as indicated or as Grade M30C, the casting equivalent of Monel® 400

## Communications Protocols & Diagnostics

### HART Protocol

#### Version:

HART 7

#### Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms See figure 2

Minimum Load: 0 ohms. (For handheld communications a minimum load of 250 ohms is required)

### Foundation Fieldbus (FF)

#### Power Supply Requirements

Voltage: 9.0 to 32.0Vdc at terminals

Steady State Current: 17.6mAdc

Software Download Current: 27.4mAdc

#### Available Function Blocks

Block Type	Qty	Execution Time
Resource	1	n/a
Transducer	1	n/a
Diagnostic	1	n/a
Analog Input	1*	30 ms
PID w/Autotune	1	45 ms
Integrator	1	30 ms
Signal Char (SC)	1	30 ms
LCD Display	1	n/a
Flow Block	1	30 ms
Input Selector	1	30 ms
Arithmetic	1	30 ms

\* AI block may have two (2) additional instantiations.

All available function blocks adhere to FOUNDATION Fieldbus standards. PID blocks support ideal & robust PID algorithms with full implementation of Auto-tuning.

#### Link Active Scheduler

Transmitters can perform as a backup Link Active Scheduler and take over when the host is disconnected. Acting as a LAS, the device ensures scheduled data transfers typically used for the regular, cyclic transfer of control loop data between devices on the Fieldbus.

#### Number of Devices/Segment

Entity IS model: 6 devices/segment

#### Schedule Entries

18 maximum schedule entries

#### Number of VCR's: 24 max

**Compliance Testing:** Tested according to ITK 6.0.1

#### Software Download

Utilizes Class-3 of the Common Software Download procedure as per FF-883 which allows the field devices of any manufacturer to receive software upgrades from any host.

#### Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and Hosts.

#### Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms See figure 2

#### Standard Diagnostics

ST 700 top level diagnostics are reported as either critical or non-critical and readable via the DD/DTM tools or integral display as shown

##### Critical Diagnostics

HART DD/DTM tools	Basic Display
Electronic Module DAC Failure	Electronics Module fault
Meter Body NVM Corrupt	Meterbody fault
Config Data Corrupt	Electronics Module fault
Electronic Module Diag Failure	Electronics Module fault
Meter Body Critical Failure	Meterbody fault
Sensor Comm Timeout	Meterbody Comm fault

##### Non-Critical Diagnostics

HART DD/DTM tools
Display Failure
Electronic Module Comm Failure
Meter Body Excess Correct
Sensor Over Temperature
Fixed Current Mode
PV Out of Range
No Factory Calibration
No DAC Compensation
LRV Set Error – Zero Config Button
URV Set Error – Span Config Button
AO Out of Range
Loop Current Noise
Meter Body Unreliable Comm
Tamper Alarm
No DAC Calibration
Sensor Supply Voltage Low

#### Other Certification Options

##### Materials

- NACE MRO175, MRO103, ISO15156

## Approval Certifications:

AGENCY	TYPE OF PROTECTION	COMM. OPTION	FIELD PARAMETERS	AMBIENT TEMP (Ta)
FM Approvals™	<b>Explosionproof:</b> Class I, Division 1, Groups A, B, C, D; <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G; T4  Class I, Zone 0/1, AEx d IIC Ga/Gb T4 Class II, Zone 21, AEx tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D, E, F, G; T4  Class I, Zone 0, AEx ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
		Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D locations,  Class I, Zone 2, AEx nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-
Canadian Standards Association (CSA)	<b>Explosion Proof:</b> Class I, Division 1, Groups A, B, C, D; <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G; T4  Ex d IIC Ga T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D, E, F, G; T4  Ex ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
		Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D; T4  Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-

### Approval Certifications: (Continued)

<b>ATEX</b>	<b>Flameproof:</b> II 1/2 G Ex d IIC Ga/Gb T4 II 2 D Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> II 1 G Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> II 3 G Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
<b>IECEx (World)</b>	<b>Flameproof :</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
<b>SAEx (South Africa)</b>	<b>Flameproof :</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
<b>INMETRO (Brazil)</b>	<b>Flameproof:</b> Ex d IIC Ga/ Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	T5 Ta = -50 to 93°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	T4 Ta = -50 to 93°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	T4 Ta = -50 to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure :</b> IP 66/67	All	All	-

**Approval Certifications: (Continued)**

NEPSI (China)	<b>Flameproof:</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 85°C	All	Note 1	T5 Ta = -50 to 93°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
		Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
<b>Enclosure :</b> IP 66/67		All	All	-
GOST	<b>Flameproof:</b> 1 Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 85°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> 0 Ex ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
		Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Enclosure :</b> IP 66/67	All	All	

Notes:

## 1. Operating Parameters:

$$\begin{array}{ll} \text{Voltage}= 11 \text{ to } 42 \text{ V DC} & \text{Current}= 4-20 \text{ mA Normal} \\ & = 10 \text{ to } 30 \text{ V (FF)} \\ & & = 30 \text{ mA (FF)} \end{array}$$

## 2. Intrinsically Safe Entity Parameters

## a. Analog/ DE/ HART Entity Values:

$$V_{max} = U_i = 30V \quad I_{max} = I_i = 105mA \quad C_i = 4.2nF \quad L_i = 984 \mu H \quad P_i = 0.9W$$

Transmitter with Terminal Block Revision E or Later )

$$V_{max} = U_i = 30V \quad I_{max} = I_i = 225mA \quad C_i = 4.2nF \quad L_i = 0 \quad P_i = 0.9W$$

Note : Transmitter with Terminal Block Revision E or later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-001 or 50049839-002
- Second line has the supplier information, along with the REVISION:

XXXXXXXX-XXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.

## b. Foundation Fieldbus- Entity Values

$$V_{max} = U_i = 30V \quad I_{max} = I_i = 180mA \quad C_i = 0nF \quad L_i = 984 \mu H \quad P_i = 1W$$

Transmitter with Terminal Block Revision F or Later )

$$V_{max} = U_i = 30V \quad I_{max} = I_i = 225mA \quad C_i = 0nF \quad L_i = 0 \quad P_i = 1 W$$

$$\text{FISCO Field Device} \quad I_{max} = I_i = 380 \text{ mA} \quad C_i = 0nF \quad L_i = 0 \quad P_i = 5.32 \text{ W}$$

V<sub>max</sub>= U<sub>i</sub> = 17.5V

Note : Transmitter with Terminal Block Revision F or later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-003 or 50049839-004
- Second line has the supplier information, along with the REVISION:

XXXXXXXX-XXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.


**Approval Certifications: (Continued)**

<b>Marine Certificates</b>	This certificate defines the certifications covered for the ST 800 Pressure Transmitter family of products, including the SMV 800 Smart Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications.  For ST 800 Smart Pressure Transmitter and SMV800 Smart Multivariable Transmitter
	<b>American Bureau of Shipping (ABS)</b> - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	<b>Bureau Veritas (BV)</b> - Product Code: 389:1H. Certificate number: 12660/B0 BV
	<b>Det Norske Veritas (DNV)</b> - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	<b>Korean Register of Shipping (KR)</b> - Certificate number: LOX17743-AE001
	<b>Lloyd's Register (LR)</b> - Certificate number: 02/60001(E1) & (E2)
<b>SIL 2/3 Certification</b>	IEC 61508 SIL 2 for non-redundant use and SIL 3 for redundant use according to EXIDA and TÜV Nord Sys Tec GmbH & Co. KG under the following standards: IEC61508-1: 2010; IEC 61508-2: 2010; IEC61508-3: 2010.

## Mounting & Dimensional Drawings)

**Reference Dimensions:** millimeters  
inches

### Mounting Configurations: (Dual head design)

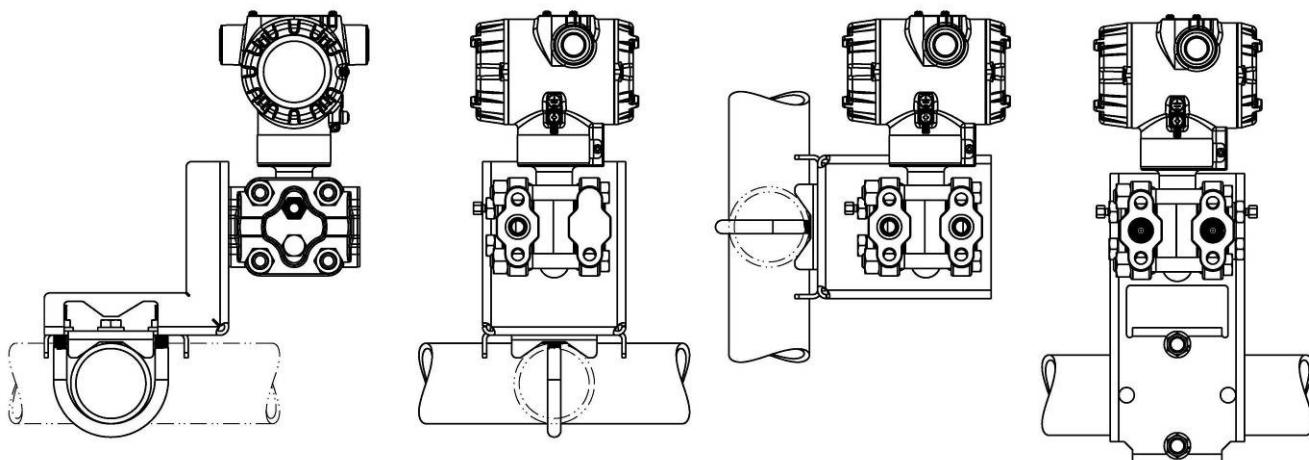

### Dimensions: (Dual head design)


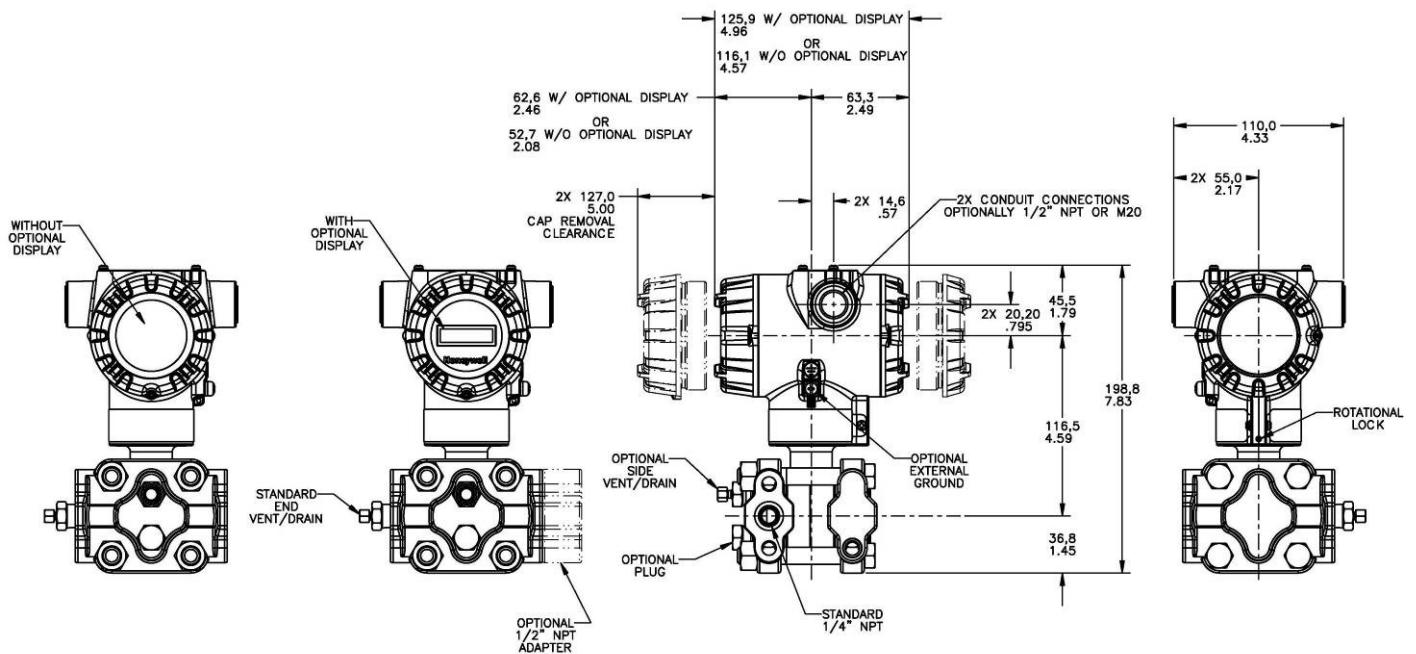


Figure 4 – Typical mounting dimensions of STG740 & STG770 for reference

**Reference Dimensions:** millimeters  
inches

### Mounting Configurations (Inline Designs)

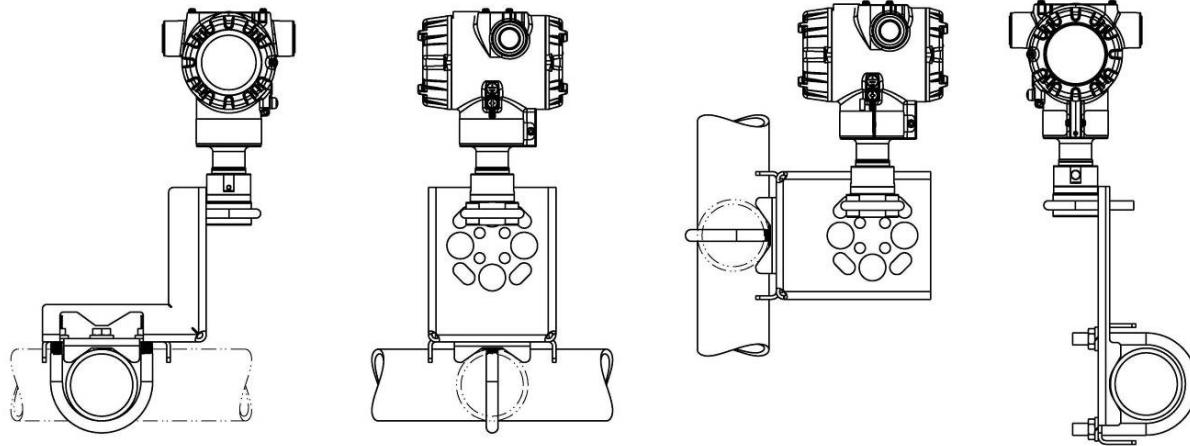

### Dimension (Inline Design)

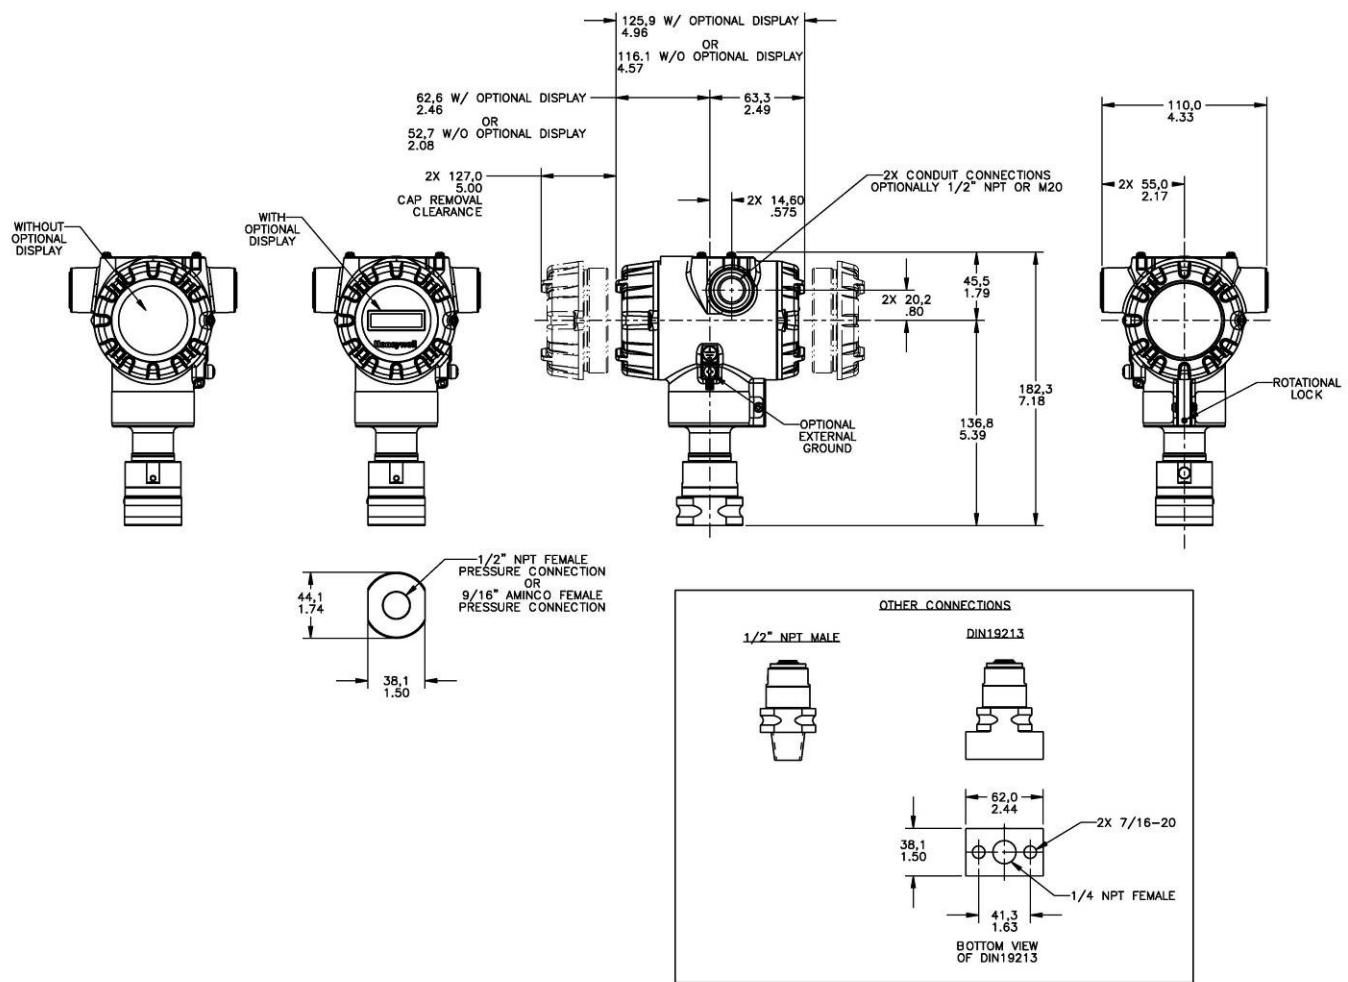


Figure 5 – Typical mounting dimensions of STG74L, STG77L, STG78L, & STG79L for reference

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.  
 Prior to specifying or ordering a model check for the latest revision Model Selection Guides which are published at:  
[www.honeywellprocess.com/en-US/pages/default.aspx](http://www.honeywellprocess.com/en-US/pages/default.aspx)

## Model Selection Guide

### Model STG700 Gauge Pressure Transmitters

#### Model Selection Guide

34-ST-16-102 Issue 7

**Instructions:** Make selections from all Tables using column below the proper arrow. Asterisk indicates availability. Letter (a) refers to restrictions highlighted in the restrictions table. Tables delimited with dashes.

Key	I	II	III	IV	V	VI	VII	VIII	IX
STG									0000

KEY NUMBER	URL/Max Span	LRL	Min Span	Units
Gauge Dual Head	50 (3.5)	-14.7 (-1.0)	0.5 (.035)	psi (bar)
	500 (35)	-14.7 (-1.0)	5 (.35)	psi (bar)
	3000 (210)	-14.7 (-1.0)	30 (2.1)	psi (bar)
Gauge In-Line	50 (3.5)	-14.7 (-1.0)	0.5 (.035)	psi (bar)
	500 (35)	-14.7 (-1.0)	5 (.35)	psi (bar)
	3000 (210)	-14.7 (-1.0)	30(2.1)	psi (bar)
	6000 (420)	-14.7 (-1.0)	60 (4.2)	psi (bar)
	10000 (690)	-14.7 (-1.0)	100 (6.9)	psi (bar)



Selection	Availability
STG730	↓
STG740	↓
STG770	↓
STG73L	
STG74L	
STG77L	↓
STG78L	↓
STG79L	↓

TABLE I METER BODY SELECTIONS			
Process Head/Reference Head Material <sup>b</sup>		Barrier Diaphragm Material	
a. Process Head & Diaphragm Materials		316L SS Plated Carbon Steel / Plated Carbon Steel Hastelloy® C - 276 Monel 400® Tantalum	
b. Fill Fluid		316L SS 316 Stainless Steel / 316 Stainless Steel Hastelloy C - 276 / 316 Stainless Steel Monel 400 / Monel 400	
c. Process Connection		Size/Type	
9/16" Amino		Same as Process Head	
1/2" NPT (female)		Same as Process Head <sup>1a</sup>	
1/2" NPT (male)		Same as Process Head	
DIN 19213 (1/4" female NPT)		Same as Process Head	
G 1/2 B Threaded Fitting		Same as Process Head	
d. Bolt/Nuts Materials		None Carbon Steel 316 SS Grade 660 (NACE A286) with NACE 304 SS Nuts Grade 660 (NACE A286) Bolts & Nuts Monel K500 Super Duplex B7M	
e. Vent/Drain Type/Location		Head Type	
None		None	
Single Ended		None	
Single Ended		Standard Vent	
Single Ended		Center Vent	
Dual Ended		Side	
Dual Ended		End	
Dual Ended		Center Vent	
Dual Ended		End	
Dual Ended		Std Vent/Plug	
f. Gasket Materials		Location	
None		None	
Teflon® or PTFE (Glass Filled)		None	
Viton®		None	
Graphite		None	

<sup>1</sup> Except Carbon Steel Heads shall use 316SS Vent/Drain & Plugs and or 1/2" adapters


<sup>1a</sup> STG730,740,770 supplied via 1/2" flange adapter same material as process head except carbon steel shall use 316 SS

<sup>1b</sup> Reference head available w/ Dual Head Gage models only. In-Line Gage models are supplied w/ Process Head only.

A	*	*			
B	*	*			
C	a	a			
D	a	a			
E	*	*	*	*	*
F	*	*	*	*	*
G	a	a			
H	a	a			
J	*	*	*	*	*
K	a	a			
L	a	a			
1	*	*	*	*	*
2	*	*	*	*	*
3	*	*	*	*	*
4	*	*	*	*	*

A	*	*	*	*
G	*	*	*	*
H	*	*	*	*
D	*	*	*	*
B	*	*	*	*
0		*	*	*
C	*	*		
S	*	*		
N	*	*		
K	p	p		
M	p	p		
D	p	p		
B	*	*		

0	*	*	*	*
1	*	*		
2	*	*		
3	t	t		
4	*	*		
5	t	t		
6	*	*		
0		*	*	*
A	*	*		
B	*	*		
C	*	*		



<b>TABLE II</b>		<b>Meter Body &amp; Connection Orientation</b>
<b>Head/Connect Orientation</b>		
Standard		High Side Left, Low Side Right <sup>2</sup> / Std Head Orientation
Reversed		Low Side Left, High Side Right <sup>2</sup> / Std Head Orientation
90/Standard		High Side Left, Low Side Right <sup>2</sup> / 90° Head Rotation

1	*	*	*	*	*
2	*	*			
3	<b>h</b>	<b>h</b>			

<b>TABLE III</b>		<b>AGENCY APPROVALS</b>
<b>Approvals</b>		
No Approvals Required		
<FM> Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof		
CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof		
ATEX Explosion proof, Intrinsically Safe & Non-incendive		
IECEx Explosion proof, Intrinsically Safe & Non-incendive		
SAEx/CCoE Explosion proof, Intrinsically Safe & Non-incendive		
INMETRO Explosion proof, Intrinsically Safe & Non-incendive		
NEPSI Explosion proof, Intrinsically Safe & Non-incendive		

0	*	*	*	*	*
A	*	*	*	*	*
B	*	*	*	*	*
C	*	*	*	*	*
D	*	*	*	*	*
E	*	*	*	*	*
F	*	*	*	*	*
G	*	*	*	*	*

<b>TABLE IV</b>		<b>TRANSMITTER ELECTRONICS SELECTIONS</b>		
		<b>Material</b>	<b>Connection</b>	<b>Lightning Protection</b>
<b>a. Electronic Housing Material &amp; Connection Type</b>	Polyester Powder Coated Aluminum	1/2 NPT		None
	Polyester Powder Coated Aluminum	M20		None
	Polyester Powder Coated Aluminum	1/2 NPT		Yes
	Polyester Powder Coated Aluminum	M20		Yes
	316 Stainless Steel (Grade CF8M)	1/2 NPT		None
	316 Stainless Steel (Grade CF8M)	M20		None
	316 Stainless Steel (Grade CF8M)	1/2 NPT		Yes
	316 Stainless Steel (Grade CF8M)	M20		Yes
<b>b. Output/Protocol</b>	<b>Analog Output</b>		<b>Digital Protocol</b>	
	4-20mAdc		HART Protocol	
	4-20mAdc		DE Protocol	
<b>c. Customer Interface Selections</b>	<b>Indicator</b>	<b>Ext Zero, Span &amp; Config Buttons</b>	<b>Languages</b>	
	None	None	None	
	None	Yes (Zero/Span Only)	None	
	Basic	None	EN	
	Basic	Yes	EN	

A __	*	*	*	*	*
B __	*	*	*	*	*
C __	*	*	*	*	*
D __	*	*	*	*	*
E __	*	*	*	*	*
F __	*	*	*	*	*
G __	*	*	*	*	*
H __	*	*	*	*	*

H _	*	*	*	*	*
D _	*	*	*	*	*
F _	*	*	*	*	*

__ 0	*	*	*	*	*
__ A	f	f	f	f	f
__ B	*	*	*	*	*
__ C	*	*	*	*	*

<b>TABLE V</b>		<b>CONFIGURATION SELECTIONS</b>			
<b>a. Application Software</b>		<b>Diagnostics</b>			
Standard Diagnostics					
<b>b. Output Limit, Failsafe &amp; Write Protect Settings</b>	<b>Write Protect</b>	<b>Fail Mode</b>	<b>High &amp; Low Output Limits<sup>3</sup></b>		
	Disabled	High> 21.0mAdc	Honeywell Std	(3.8 - 20.8 mAdc)	
	Disabled	Low< 3.6mAdc	Honeywell Std	(3.8 - 20.8 mAdc)	
	Enabled	High> 21.0mAdc	Honeywell Std	(3.8 - 20.8 mAdc)	
	Enabled	Low< 3.6mAdc	Honeywell Std	(3.8 - 20.8 mAdc)	
	Enabled	N/A	N/A	Fieldbus	
<b>c. General Configuration</b>	N/A	N/A	Fieldbus		
	Factory Standard				
Custom Configuration (Unit Data Required from customer)					

1 __	*	*	*	*	*
------	---	---	---	---	---

_ 1 _	f	f	f	f	f
_ 2 _	f	f	f	f	f
_ 3 _	f	f	f	f	f
_ 4 _	f	f	f	f	f
_ 5 _	g	g	g	g	g
_ 6 _	g	g	g	g	g


__ S	*	*	*	*	*
__ C	*	*	*	*	*

<sup>2</sup> Left side/Right side as viewed from the customer connection perspective

<sup>3</sup> NAMUR Output Limits are configurable by customer

**TABLE VI****CALIBRATION & ACCURACY SELECTIONS**

a. Accuracy and Calibration	Accuracy	Calibrated Range	Calibration Qty
	Standard Standard	Factory Standard Custom (Unit Data Required)	Single Calibration Single Calibration

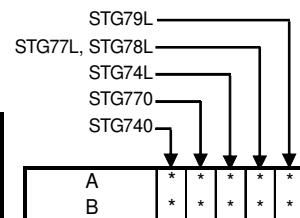**TABLE VII****ACCESSORY SELECTIONS**

a. Mounting Bracket	Bracket Type	Material
	None	None
	Angle Bracket	Carbon Steel
	Angle Bracket	304 SS
	Angle Bracket	316 SS
	Marine Approved Bracket	Carbon Steel
	Marine Approved Bracket (In-Line)	Carbon Steel
	Marine Approved Bracket	304 SS
	Marine Approved Bracket (In-Line)	304 SS
	Flat Bracket	Carbon Steel
b. Customer Tag	Customer Tag Type	
	No customer tag	
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line)	
c. Unassembled Conduit Plugs & Adapters	Unassembled Conduit Plugs & Adapters	
	No Conduit Plugs or Adapters Required	
	1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter	
	1/2 NPT 316 SS Certified Conduit Plug	
	M20 316 SS Certified Conduit Plug	
	Minifast® 4 pin (1/2 NPT) (not suitable for X-Proof applications)	
	Minifast® 4 pin (M20) (not suitable for X-Proof applications)	

0	*	*	*	*	*	*
1	*	*	*	*	*	*
2	*	*	*	*	*	*
3	*	*	*	*	*	*
8	*	*				
9	*	*	*	*	*	*
4	*	*				
A	*	*	*	*	*	*
5	*	*	*	*	*	*
6	*	*	*	*	*	*
7	*	*	*	*	*	*

-0	*	*	*	*	*
-1	*	*	*	*	*
-2	*	*	*	*	*

--A0	*	*	*	*	*
--A2	n	n	n	n	n
--A6	n	n	n	n	n
--A7	m	m	m	m	m
--A8	n	n	n	n	n
--A9	m	m	m	m	m

**TABLE VIII****OTHER Certifications & Options: (String in sequence comma delimited (XX, XX, XX,...))**

Certifications & Warranty	No additional options
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only
	NACE MR0175; MR0103; ISO15156 (FC33339) Process wetted and non-wetted parts
	Marine (DNV, ABS, BV, KR, LR)
	EN10204 Type 3.1 Material Traceability (FC33341)
	Certificate of Conformance (F3391)
	Calibration Test Report & Certificate of Conformance (F3399)
	Certificate of Origin (F0195)
	FMEDA (SIL 2/3) Certification (FC33337)
	Over-Pressure Leak Test Certificate (1.5X MAWP) (F3392)
	Cert Clean for O <sub>2</sub> or Cl <sub>2</sub> service per ASTM G93

00	*	*	*	*	*	*
FG	*	*	*	*	*	b
F7	c	c	c	c	c	
MT	d	d	d	d	d	
FX	*	*	*	*	*	
F3	*	*	*	*	*	
F1	*	*	*	*	*	
F5	*	*	*	*	*	
FE	j	j	j	j	j	
TP	*	*	*	*	*	
OX	e	e	e	e	e	

**TABLE IX****Manufacturing Specials**

Factory	Factory Identification
---------	------------------------

0	0	0	*	*	*	*	*
---	---	---	---	---	---	---	---

**RESTRICTIONS**

Restriction Letter	Available Only with		Not Available with		
	Table	Selection(s)	Table	Selection(s)	
a			VIII	FG, F7	
c	Id	_0,N,K,D,B_	I a	C,D,G,H,K,L_	
d			VIIa	1,2,3,5,6,7_	
e	lb	_2_			
f			IV b	F_	
g			IVb	H,D_	
h			le	4, 5, 6_	
			VIIa	1,2,3,4,5,6,7_	
j	IV b	_H_	Vb	1,2,6_	
m	IV a	B,D,F,H_			
n	IV a	A,C,E,G_			
p			III	B- No CRN number available	
t			Ia	J, K, L_	
b	Select Only one option from this group				

## Sales and Service

For application assistance, current specifications, pricing, or name of the nearest Authorized Distributor, contact one of the offices below.

### ASIA PACIFIC

Honeywell Process Solutions,  
(TAC) [hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

#### Australia

Honeywell Limited  
Phone: +(61) 7-3846 1255  
FAX: +(61) 7-3840 6481  
Toll Free 1300-36-39-36  
Toll Free Fax:  
1300-36-04-70

**China – PRC - Shanghai**  
Honeywell China Inc.  
Phone: (86-21) 5257-4568  
Fax: (86-21) 6237-2826

#### Singapore

Honeywell Pte Ltd.  
Phone: +(65) 6580 3278  
Fax: +(65) 6445-3033

#### South Korea

Honeywell Korea Co Ltd  
Phone: +(822) 799 6114  
Fax: +(822) 792 9015

### EMEA

Honeywell Process Solutions,  
Phone: + 80012026455 or  
+44 (0)1344 656000

Email: (Sales)  
[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)  
or  
(TAC)  
[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

### AMERICA'S

Honeywell Process Solutions,  
Phone: (TAC) 1-800-423-9883 or  
215/641-3610  
(Sales) 1-800-343-0228

Email: (Sales)  
[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)  
or  
(TAC)  
[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

*Specifications are subject to change without notice.*

### For more information

To learn more about SmartLine Pressure  
Transmitters visit [www.honeywellprocess.com](http://www.honeywellprocess.com)  
Or contact your Honeywell Account Manager

### Process Solutions

Honeywell  
1250 W Sam Houston Pkwy S  
Houston, TX 77042

Honeywell Control Systems Ltd  
Honeywell House, Skimmed Hill Lane  
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road  
Shanghai, China 20061

[www.honeywellprocess.com](http://www.honeywellprocess.com)

34-ST-03-102

December 2014

©2014 Honeywell International Inc.

**Honeywell**